

Leading the way in hazardous area static control

Application Spotlight



Online
Inquiry >



Controlling the Risk of Ignitions by Static Electricity in Intermediate and Specialty Chemical Operations

High levels of safety awareness in the intermediate and specialty chemical industry have been in place for decades and the management and mitigation of ignition source risk has always been a major practice for safety professionals, operations managers and engineers.

Static as an ignition source

Static electricity is just one of several sources of ignition regularly identified as being responsible for the ignition of combustible atmospheres (Gas and/or Dust) and there are a range of site wide operations that can result in the generation of static electricity. Whether the operation involves [filling](#), dispensing flammables or [conveying/tipping](#) powders into vessels, static electricity can be generated just through the movement of the material being processed or handled.

Because static electricity has long been known to present an ignition source in hazardous location operations, it is highlighted in U.S. legislation under OSHA Standard 1910.106(b)(6) “Flammable Liquids” which states:

Sources of ignition

“In locations where flammable vapors may be present, precautions shall be taken to prevent ignition by eliminating or controlling sources of ignition. Sources of ignition may include open flames, lightning, smoking, cutting and welding, hot surfaces, frictional heat, sparks (static, electrical, and mechanical), spontaneous ignition, chemical and physical-chemical reactions, and radiant heat.”

Canada’s Occupational Health and Safety Regulations, SOR/86-304, 10.12(1) state:

10.12 (1) Where, in a work place, a hazardous substance is capable of combining with another substance to form an ignitable combination and there exists a hazard of ignition of the combination by static electricity, the employer shall implement the standards set out in the United States National Fire Protection Association, Inc. publication NFPA 77, Recommended Practice on Static Electricity, dated 1988*, as amended from time to time.

*The current version of NFPA 77 “Recommended Practice on Static Electricity” was released in 2019.

Getting to grips with static electricity

Although it is easy to understand why static electricity can be perceived as a mysterious topic to get to grips with, the principles around which static electricity can present an ignition source risk are relatively straightforward.

One common denominator is the interaction of electrically insulating materials (materials that have a low conductivity, e.g. toluene) with electrically conductive materials (e.g. plant equipment constructed from metals).

When an insulating material like toluene comes into contact with metal plant equipment, whether it’s flowing in piping, through a filter or being deposited into a drum

“ the toluene attracts electrons from the metal surface of the equipment it is in dynamic contact with. ”

The net result of this interaction is that the toluene is rapidly building a negative electrical charge, as it is attracting negatively charged electrons from the conductive metal, while the metal equipment is rapidly building a positive electrical charge.


The problem with this situation, if it is allowed to continue, is that the voltage of both materials will rise rapidly if both materials are “isolated” from the earth.

Any object isolated from the earth can be described as possessing an “electrical capacitance” which is denoted with the symbol “C” and is measured in Farads.

Static Accumulating Liquids	Static Accumulating Powders
Benzene	PTFE
Diesel	Polyethylene
Gasoline	PMMA
Light Crude	Wood
Crude/Gas Condensates	Polyurethane
Jet Fuel	PVC
Kerosene	Pyrex
Toluene	Neoprene
Xylene	Nylon
Hexane	Polypropylene
Heptane	Polystyrene

Table 1 - Examples of static accumulating materials

If we take the example of the toluene building a continuous negative charge as it flows through the metal piping system and gets deposited into an object like a metal drum, which, in this example, is isolated from earth, the drum will build a negative charge on its outside surface. The reason for this is that the negative voltage of the toluene forces the electrons in the drum to the outside surface of the drum. This is caused by the “rule-of-thumb” principle that like charges repel and unlike charges attract.

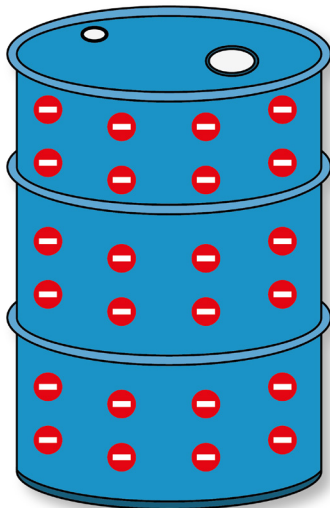

Negative electrical charges distributed on external surface

The problem with this scenario is that the voltage of the drum will rise based on the amount of negative charge residing on its outer surface relative to its own value of capacitance.

The more static electrical charge, the higher the voltage. This scenario can be best explained through the formula:

$$V = \frac{Q}{C}$$

Where:

- V = voltage of charged objects (volts)
- Q = total quantity of charge on the object (coulombs)
- C = capacitance of charged object (farad)

(Source: NFPA 77 : 6.3.1)

As more charge is deposited on the isolated object there is a constant voltage rise. In our example, this is the outside surface of the drum as it is being filled with the toluene.

Item	Capacitance (pF)
Tank Car	1000
Automobile	500
Person	100-300
Oil/Solvent Drum	10-100
Metal Scoop	10-20
Needle Electrode	1
Dust Particle	10 ⁻⁷

Table 2: Capacitance of objects routinely used in the movement and containment of hazardous products. (Source: NFPA 77 "Recommended Practice on Static Electricity, Table A.3.3.5, (2019 - Table A.2))

As the voltage rapidly rises and the electrical field strength around the surface of the drum passes 3000 volts per millimeter (the breakdown voltage of air at ambient conditions) then there is a real risk that an electrostatic spark will be discharged from the surface of the drum into the potentially combustible atmosphere. In order to initiate combustion of the atmosphere, assuming it is within its ignitable range, the energy of the resulting spark must exceed the minimum ignition energy (MIE) of the surrounding flammable atmosphere.

The potential energy of an electrostatic spark discharge can be illustrated in the formula:

$$W = 0.5CV^2$$

Where:

- W = spark energy (joules)
- C = capacitance of isolated object (farad)
- V = voltage of isolated objects (volts)

(Source: NFPA 77 : 6.9.1)

If it is assumed that the voltage of the object has exceeded the breakdown voltage of the surrounding atmosphere and is charged to a voltage of, say, 10,000 volts at the moment when there is a spark discharge to another object in close proximity to the drum, the potential energy of the resulting spark would be approximately 2.5 mJ. This assumes the drum has a minimum capacitance of 50 pF as indicated in Table 2. If we are assuming that the flammable mixture surrounding the drum is a toluene-air vapour the minimum ignition energy would be in the region of 0.24 mJ (source: NFPA 77 "Recommended Practice on Static Electricity (2019 - Table B.1)) then the resulting energy from the spark would be capable of initiating combustion of the vapour.

Charge generation is not just limited to liquids. Powder processing operations can produce electrostatic charging rates well in excess of liquids and gases.

Processes capable of generating static electricity

In the intermediate and specialty chemicals sector there are many processes that can result in the generation of static electricity as a natural by-product of the process in question. Such examples include but are not limited to:

- Bulk material transfer into or out of road tankers and railcars.
- IBC and drums that are being filled, emptied, or being used as mixing and blending vessels.
- Transferring liquids and powders via hoses.
- Filling or emptying vessels and FIBC with powders.
- Even people, if they are wearing insulating footwear or are walking on insulating surfaces, can accumulate large voltages on their body without even sensing it.

However, the vast majority of these situations can be managed by ensuring the objects at risk of static charge accumulation are not isolated from earth. Because fixed plant like large storage tanks and vessels should be earthed via the plant structure, the risk of static spark discharges is most pronounced for moveable objects ranging from road tankers to people.

Charge build up on powders

Operation	Mass Charge Density ($\mu\text{C kg}^{-1}$)
Triboelectrical Powder Coating	10,000 to 1,000
Pneumatic Conveying	1,000 to 0.1
Micronising	100 to 0.1
Grinding	1 to 0.1
Scroll Feed Transfer	1 to 0.01
Pouring	1 to 0.001
Sieving	0.001 to 0.000 01

Table 3 - Charge build up on powders through different processing techniques and the quantity of charge typically carried per kilogram of powder. (Source: IEC TS 60079-32-1 "Explosive atmospheres, Part 32-1: Electrostatic hazards, guidance" - Table A.1).

Table 4 highlights some of the sources of electrical isolation on moveable equipment. If the objects are connected to earth then the charge imbalance on the object is neutralized which mitigates the risk of a static spark with enough energy to ignite potentially combustible atmospheres.


Grounding and Bonding

Grounding potentially isolated equipment should be regarded as a compulsory safety function in any process and area where combustible products are handled and processed. It is the most practical and effective way of preventing the accumulation of static electricity on equipment (and people). However, having objects in contact with ground is not grounding. For example, resting a drum on concrete or using drag chains on road tankers does not provide an effective and reliable means of preventing static charge accumulation. So what does "grounding" really mean? In effect, if we can connect our potentially isolated equipment to a verified "true earth ground" i.e. a connection to the general mass of the earth that has been measured and verified to be below 25 Ohms, in accordance with a standard like the NFPA 70 "National Electrical Code", we can be confident that connecting to installed ground networks like the local lightning and electrical ground protection circuits will enable static charges to dissipate safely from the process equipment. The bus-bar network that feeds out from the ground rods (installed ground network) can provide a means of grounding our process equipment.

Objects	What causes capacitance?
Portable Drums	Protective coatings, product deposits, rust
Road Tankers	Rubber tyres
Piping	Rubber and plastic seals, anti-vibration pads and gaskets
Rail Tankers	Grease, vibration pads isolating tank from rail cars. Rails isolated from loading gantry
People	Soles of footwear
Scoops	Rubber gloves
Hoses	Broken internal helixes and bonding connectors
FIBC	Non-conductive fabric / damaged static dissipative threads

Table 4 - Examples of why process equipment and people can be isolated from earth

Controlling the Risk of Ignitions by Static Electricity in Intermediate and Specialty Chemical Operations

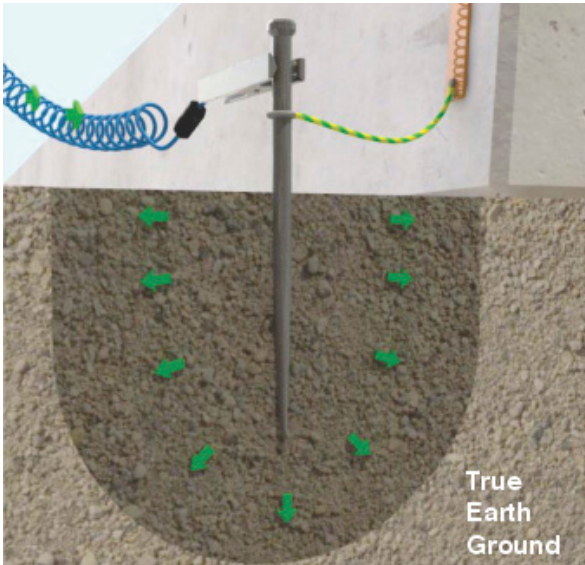

Bonding is different to grounding in that it ensures that two bonded objects at risk of static charge accumulation are at the same electrical potential, however, it does not mean they have no charge, i.e. are at ground potential (0 volts). Bonding ensures there is no risk of static spark discharges between the bonded objects. It does not mean they are not capable of discharging sparks to objects at a lower electrical potential. A benchmark resistance of 10 Ohms between the object requiring static grounding protection and the site's verified ground network should be targeted in daily operations.

Section 7.4.1.3.1 of NFPA 77, "Recommended Practice on Static Electricity"

Where the bonding/grounding system is all metal, resistance in continuous ground paths typically is less than 10 Ohms. Such systems include those having multiple components. Greater resistance usually indicates that the metal path is not continuous, usually because of loose connections or corrosion. A permanent or fixed grounding system that is acceptable for power circuits or for lightning protection is more than adequate for a static electricity grounding system.

A resistance of 10 Ohms or less refers to the resistance between the object requiring static grounding protection and the local ground network. Any resistance higher than this value would indicate loose connections or corrosion which could limit the dissipation of electrostatic charges from the equipment undergoing electrification. The challenge, however, is to ensure we implement a consistent and reliable means of connecting to these networks,

especially since most of the equipment we are dealing with is portable and will not have a permanent connection to the site's local ground network.

For movable metal objects this extract from IEC TS 60079-32-1 "Explosive atmospheres, Electrostatic hazards, guidance" recommends the following:

Section 13.4 "The establishment and monitoring of earthing systems":

13.4.1 Design

Permanent bonding or earthing connections should be made in a way to provide low resistance during its lifetime, e.g. by brazing or welding. Temporary connections can be made using bolts, pressure-type earth clamps, or other special clamps. Pressure-type clamps should have sufficient pressure to penetrate any protective coating, rust, or spilled material to ensure contact with the base metal with an interface resistance of less than 10 Ω .

Implementing practical grounding solutions

The implementation of a consistent and repeatable way of grounding mobile equipment needs to take into account the characteristics of the process, who the responsible people are for performing the grounding and bonding safety function on a daily basis and other factors like environmental conditions and the classification of the hazardous location.

Whatever method is adopted it is critical to ensure that the person (people) responsible for performing the safety function of grounding equipment understand the importance of doing it and that the grounding activity itself is kept relatively simple. There are many cases where sites with good grounding practices have been caught out either due to forgetfulness on the part of an operator or because a minor flaw in the process has been missed.


Industrial grade grounding clamps

Grounding clamps are the most "traditional" means of connecting mobile plant equipment to verified grounding points. However equipment specifiers need to be aware of the difference between clamps like alligator clips as compared with static grounding clamps that have been designed for repeated use in harsh industrial environments.

Controlling the Risk of Ignitions by Static Electricity in Intermediate and Specialty Chemical Operations

Clamps like alligator clips are designed to be attached to clean surfaces like battery terminals. They are not designed to penetrate industrial grade protective coatings product deposits on equipment (ref: IEC TS 60079-3-21, 13.4.1 “Design” above) that would otherwise not permit static charges to pass through them. So even though the clamp may be attached to the object it does not mean it is effectively grounding it.

Clamps that combine a strong spring pressure with sharp rugged teeth have a greater chance of penetrating surfaces that would otherwise prevent a reliable electrical and mechanical connection to the equipment undergoing electrification by electrostatic charging.

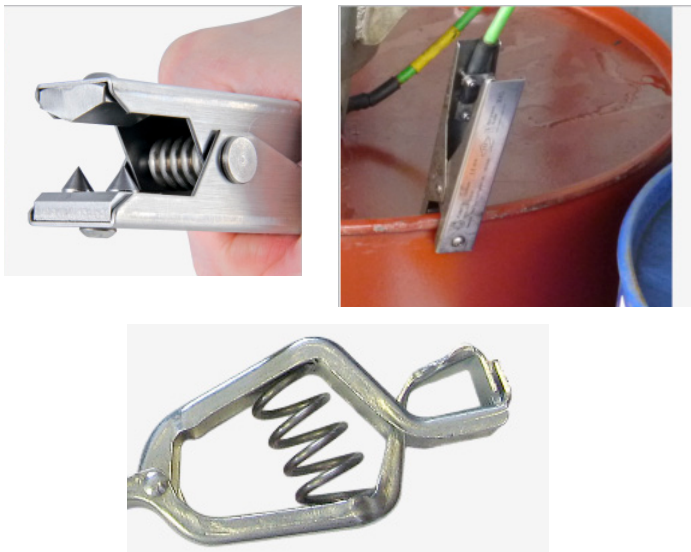

FM approved grounding clamps with rugged sharpened teeth are more likely to penetrate coatings and achieve effective grounding of equipment than basic clips and clamps.

Clamps that carry the FM approval mark will have passed a range of tests that demonstrate key functional performance characteristics to operate successfully. These tests include:

- Clamp pressure testing
- Pull resistance testing
- Electrical continuity testing (less than 1 Ohm)
- Clamp connection testing in response to a range of vibrating frequencies

Although the use of a basic grounding clamp will not verify a low resistance connection to equipment for the operator,

“ ***selecting a grounding clamp that combines FM approval with a set of sharp teeth capable of penetrating layers that would otherwise inhibit static charge transfer will enhance the likelihood of repeatable and reliable ground connections to plant equipment.*** ”

Verifying a positive ground connection

Combining certified grounding clamps with a [ground monitoring system](#) adds the benefit of providing positive confirmation to operators that a 10 Ohm or less connection to the plant equipment requiring static grounding protection has been achieved after they have attached the grounding clamp. This effectively removes the “guesswork” out of knowing whether or not the equipment is grounded. Once a connection of 10 Ohms or less has been verified by the system, an indicator like a pulsing green LED will let the operator know that he/she can proceed with the operation (e.g. filling or mixing operation).

The benefit of the pulsing green LED principle is that it lets people in the area know that the system is continuously monitoring the health and effectiveness of the grounding circuit and that should the resistance rise above 10 Ohms, or the clamp’s connection to the equipment be compromised in any way that the LED will switch off. This will notify people working in the area that the process should be halted or if it cannot be halted that the equipment should not be approached until an adequate charge relaxation time period has been adhered to after the process has finished.

The use of a ground circuit monitoring system with an indicator has the added benefit of becoming a core step in the operator’s Standard Operating Procedures (SOP) so that if the green light is not obtained the process should not begin. It also enhances the site’s ability to demonstrate compliance with the recommendations of NFPA 77 and IEC TS 60079-32-1 by ensuring the process does not start unless a verified 10 Ohm or less connection has been achieved.

Ground verification with interlocks

If the process that causes charge generation is automated an alternative option is to specify a [grounding system](#) that will not only verify and indicate a ground connection resistance of 10 Ohms or less, but through its dry contacts, control the process (e.g. road tanker loading operation). Unless the grounding system detects a 10 Ohm or less connection it will not permit the process to begin. It should be borne in mind that if the grounding system is interlocked with devices to control the flow/movement of material that although the device causing material movement (e.g. pump) may have stopped (e.g. through accidental removal of the clamp mid-transfer) there could be a period of time before the flow or movement of material stops completely. It is the responsibility of the customer to determine what measures need to be in place to manage scenarios where static charge could still be present. Likewise, if the clamp's connection or the grounding circuit should be compromised during the process, the grounding system will automatically detect this situation and halt the process, thereby stopping the further generation and accumulation of static electricity on the process equipment.

The benefit of this type of system is that it really enforces the Standard Operating Procedures (SOP) of grounding the object prior to process initiation.

Again, what needs to be borne in mind is that the person tasked with ensuring the safety function of grounding the equipment is actioned via an easy and repeatable way of grounding the equipment. The most effective way of getting acceptance and engagement from the operator is to keep the visual indication and mode of operation as simple as possible.

A simple red "NO-GO", green "GOOD-TO-GO" method of indication is a simple but effective concept for people to engage with.

This in line with a simple action of connecting the grounding clamp to the object requiring grounding, without any additional need to interface with switches and dials, simplifies the procedure.

Newson Gale

Newson Gale has been providing static grounding and bonding solutions to the hazardous process industries for over 30 years. In that time we have developed a wide range of solutions, and many "industry firsts", to cater for a wide range of industry processes, installation settings and end user preferences. Our hardware is designed to support our customers in demonstrating compliance with industry guidance like NFPA 77 and IEC TS 60079-32-1 and all possess the necessary and most up to date North American (cCSAus), ATEX, and IECEx hazardous location approval certificates.

Whether your communication preference is through e-mail, video conferencing, online chat or by phone our global team of sales engineers will be more than happy to discuss your processes and outline the range of grounding and bonding solutions that match your requirements.

If you have any questions relating to the topics discussed in this article, please contact Newson Gale.



Copyright Notice

The website and its content is copyright of Newson Gale Ltd © 2020. All rights reserved.

Any redistribution or reproduction of part or all of the contents in any form is prohibited other than the following:

- you may print or download to a local hard disk extracts for your personal and noncommercial use only
- you may copy the content to individual third parties for their personal use, but only if you acknowledge the website as the source of the material

You may not, except with our express written permission, distribute or commercially exploit the content. Nor may you transmit it or store it in any other website or other form of electronic retrieval system.

Right to change

This document provides general information only and may be subject to change at any time without notice. All information, representations, links or other messages may be changed by Newson Gale at any time without prior notice or explanation.

Newson Gale is not obliged to remove any outdated information from its content or to expressly mark it as being outdated. Please seek the advice of professionals as necessary regarding the evaluation of any content.

Disclaimer of liability

The information provided in this Application Spotlight is provided by Newson Gale without any representations or warranties, expressed or implied, as to its accuracy or completeness. The liability of Newson Gale for any expenses, losses or actions incurred whatsoever by the recipient as a result of the use of this Application Spotlight shall be excluded.

Leading the way in hazardous area static control



7/7

United Kingdom
Newson Gale Ltd
Omega House
Private Road 8
Colwick, Nottingham
NG4 2JX, UK
+44 (0)115 940 7500
groundit@newson-gale.co.uk

United States
IEP Technologies LLC
417-1 South Street
Marlborough, MA 01752
USA
+1 732 961 7610
groundit@newson-gale.com

Deutschland
IEP Technologies GmbH
Kaiserswerther Str. 85C
40878 Ratingen
Germany
+49 (0)2102 58890
erdung@newson-gale.de